

Starline S.p.A. Via F.Baracca, 28/A 24060 San Paolo D'Argon. BG (Italy) tel.035/958041 - 035/958102 Fax 035/958413

e-mail: starline@starline.it www.starline.it


Prepared by: Technical Dept. Checked by: Q.C. Manager Approved by: Q.A. Manager

Revision: 0 dtd 08/03/2010

MANUAL INSTRUCTION No.124-T1/10 FOR STORAGE, INSTALLATION, OPERATION AND MAINTENANCE FOR STARLINE BALL VALVES TYPE THREADED No.1.

REFERENCE: STARLINE CATALOGUE Q.A.M. AND PURCHASE ORDER Page: 1 of 1

N.1 THREADED

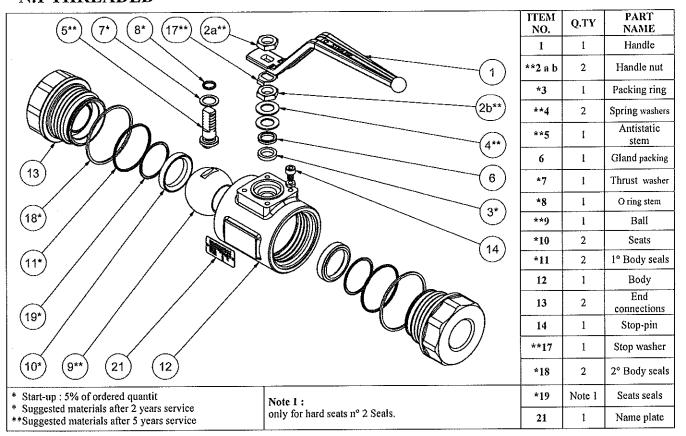

ORDER N.:....

ITEM N.:....

VALVE SIZE				SEAT AREA			STEM AREA			BODY SEAL AREA	END CONN. SEALS
FULL BO	FULL BORE) 1	PART N.10 SEATS		PART N.19 SEAT SEALS*	PART N.3 PACKING RING	PART N.7 THRUST WASHER	PART N.8 O RING STEM	PART N.11 SEAL	PART N.18 SEAL
	DN		so	SOFT HARD							
DN 08		DN 10	T		N□	ТП	T□	T□	V 🗆	V 🗆	G 🗆
DN 10		DN 15	s		P□	G 🗆	R 🗆	S□	N□	N□	□
DN 15		DN 20	□ B		D 🗆	V 🗆	S□	P 🗆	нп	ΗО	
DN 20		DN 25	G		K□	N□	υo	0	E□	EΠ	
DN 25		DN 32	<u> </u>		E	н□	G+S 🗆		0	0	
DN 32		DN 40				EΩ	When G is used on top there is a				
DN 40		DN 50				0	ring in S 0,6mm for antiextrusion				
DN 50		DN 65					0				
DN 65	П	DN 80									
DN 80		DN 100									

TABLE WITH TIGHTNESS VALUES FOR HANDLE NUT 2A-2B

VALV	/E SIZE	HANDLE NUT 2 A and LOCK NUT 2 B				
FULL BORE	REDUCE BORE	DIMENSIONS	Nm	INCH LBS		
DN 08-10-15	DN 15-20	M10x1	8	70		
DN 20-25	DN 25-32	M12x1.25	15	130		
DN 32-40-50	DN 40-50-65	M15x1.5	25	220		
DN 65	DN 80	M12x1.5	40	335		
DN 80	DN 100	M24x2	50	440		

1.0 SCOPE

This manual is intended as a guide to assist customers or end-users for storage, installation, and maintenance of Starline ball valves in the standard arrangements. For this reason subsequent additions and special instruction to the present manual will be provided in case of special ball valve, critical services or customer requirements.

2.0 APPLICABILITY

This manual is applicable to Starline ball valves.

3.0 STORAGE

3.1 INFORMATION ON SURFACE PROTECTION (EXTERNAL/INTERNAL) AND PACKING DETAILS.

- a- before shipment from Starline factory all c.s. valves (A105-LF2) are protected against corrosion by phosphated treatment.
- b- all S.S. valves (304-316-F51-F44-F321 etc.) are pickled and passivated
- c- a pure vaseline oil is used as lubricant on all internal surfaces, this may be removed with a solvent if found objectionable. All valves are adequately packed into a strong cardboard case in such a way to avoid any possible damage during transport and storage period before use.

3.2 CAUTION AND MAINTENANCE PERIOD

3.3 IF BALL VALVES ARE NOT DESTINATED FOR IMMEDIATE USE FOLLOWING CAUTIONS MUST BE TAKEN:

- a- if possible it would de advisable to leave the ball valves in their own packing cases during the entire period of storage.
- b-ball valve must remain in open position during all this time
- c- in order to prevent any damage, the protective plastic cover on the ends of the valves shall not be removed.

3.4 ATMOSFERIC PROTECTION

a- it is advisable to store the valve in waterproof conditions in a building with an adequate roof. Ball valves shall be protected to safeguard against all the environments: humidity, moisture, rain, dust, dirt, sand, mud, salt air, salt spray and seawater.

b- all valves complete with actuators are to be stored in closed and dry conditions.

3.5 LONG STORAGE PERIOD

Valves to be stored for a long time shall be checked by the quality control personnel every 6 months; every 3 months when valves are actuated.

3.6 MAINTENANCE DURING STORAGE PERIOD

- a- internal surface must be inspected to check complete dust or other foreign parts absence
- b- old rust or any dust must be removed by wiping with proper solvent
- c- after cleaning, ball valves must be lubricated by using an adequate lubricant
- d-ball valves must be operated for a least 2 complete cycles

4.0 INSTALLATION

$4.1\ \mathrm{THE}\ \mathrm{BALL}\ \mathrm{VALVES}\ \mathrm{MAY}\ \mathrm{BE}\ \mathrm{INSTALLED}\ \mathrm{IN}\ \mathrm{ANY}\ \mathrm{POSITION}\ \mathrm{USING}\ \mathrm{A}\ \mathrm{STANDARD}\ \mathrm{PIPE}$ FITTING PRACTICES

4.2 INFORMATION AND CAUTION BEFORE INSTALLATION OF THE VALVE

- a- pipe must be free of tension
- b- pipe must be flushed to clean the dirt, burrs, calamines, welding residues etc. which would damage ball and seats
- c- the valve must be kept in OPEN POSITION during installation and protective plastic cover must be removed only at the moment of installation
- d- at the moment of the shipment the ball is lubricated with a pure vaseline oil, which can be easily removed with a solvent if required
- e-ball valves normally have a space between ball and inside cavity of the body which could trap the product, care should be taken to drain the cavity.
- f- care should always be taken to install the automated ball valves. Check for a correct actuator rotation and well done electrical connection

4.3 INSTALLATION OF THREADED ENDS

Use conventional sealant such as hemp core, ptfe etc

4.4 INSTALLATION OF WELDED ENDS BALL VALVES

A SW - BW with short ends instructions for welding the valve on the line: 1- tack weld in four points on both end-cap 2- lift-out the center piece and complete the welding 3- insert the center piece and control for easy operation

B WELDED NIPPLES - or integral nipple instructions for welding the valves on the line: with valve in open position tack weld in four points on both ends and then complete the welding without dismantling the valve and control for easy operation

4.6 INSTALLATION OF FLANGED ENDS

Easy fitting on the adequate bolts, nuts and gaskets.

5.0 OPERATION

CAUTION! during the operation the ball valves must be in either complete OPEN or CLOSED position in order to ensure their smooth and efficient working and long duration of seats. Leaving the ball in half open position could eventually cause damage to the soft seats.

5.1 MANUAL OPERATION

The opening and closing of the valve is done by turning the handle a quarter turn (90°) a-valve is in open position when the handle is in line with the valve and pipe line b-valve is in closed position when the handle is across the pipe line

5.2AUTOMATED OPERATION

Valve can be automatically operated by: A: pneumatic actuators (DA or SR), B: hydraulic actuators C: electrical actuators D: gear box (manually operated). In this case no stop is fitted on the valve since it is normally a part of the actuators.

6.0 MAINTENANCE

CAUTION! Before starting the maintenance be sure that all pressure on the pipe is relieved.

- open and close the ball valve at least once to release the pressure completely also from the valve body.
- the ball valves if correctly used, normally do not need any internal lubrication and maintenance. However, when necessary, ball, or seats can be replaced only by relatively qualified personnel following the instruction of the manual without needs to use any machinery.
- for further information about the recommended SPARE PARTS LIST please check drawing, catalogue or contact the factory.

6.1 STEAM LEAKAGE

If leakage is evident on stem packing area, it can be eliminated by increasing the tightness of the lock nut 2B. In case leakage is still persisting the replacement of the stem packing 3 is recommended. For handle nut and lock nut (2A-2B) tightness see table.

6.2 BODY SEALS LEAKAGE

Valve must be disassembled to replace damaged parts.

6.3 IN LINE OR SEATS LEAKAGE

Check that valve is in fully closed position if so and the leakage is persisting the valve must be disassembled to replace damaged parts.

6.4 SAFETY PRECAUTION BEFORE REMOVING THE BALL VALVE FROM THE LINE FOR DISASSEMBLE

a- check that all pressure is exhausted from the line (upstream and downstream) and half open the ball to ensure that no pressure is trapped in the body cavity. In other words it must be drained of all fluid/gas and pressure.

b- remove the valve from the line and cycle valve at minimum 1 full cycle to ensure that any pressure trapped is released

- c-CAUTION! If the fluid in the line and into the valve is toxic, inflammable, corrosive or damaging for any other reason, it is advisable to take following precaution during the valve repairing:
- use protective eye mask or glasses
- use gloves, overalls and suitable footwear
- ensure that running water and fire extinguisher is easily available at any moment

7.0 VALVE DISASSEMBLY TO INSPECT AND/OR REPLACE BODY SEALS, SEATS, PACKING AND BALL

a- set the valve in open position and un-tight the end connections

b- close the valve and remove seats and seat seals 10+19, ball 9 and body seals 11+18, be careful not to damage the ball

c-remove handle nut 2A, handle 1, stop washer 17, lock nut 2B, spring washer 4, gland packing 6

d- push the stem 5 into the body 12. Remove packing rings 7 from body and o-ring 8 plus thrust-washer 7 from stem.

8.0 INSPECTION AND REPLACEMENT

With the valve completely disassembled, clean and examine all the following components:

a- surface of the ball: any surface defect, particularly in the seating area will be extremely detrimental to the performance of the valve and therefore the ball should be replaced if found defective

b- seats: replacement of seats is recommended

c- stem seals and body seals: also to be discharged and replaced by a new one

d-remaining components of the valve: after cleaning it is required a careful examination for wear, corrosion and mechanical, damages particularly on threaded components. If components are found defective they should be replaced.

9.0 RE-ASSEMBLY

Clean inside of body and stem housing. A light oil/grease compatible with line fluid can be used on ball, seats and stem surfaces.

9.1 STEM RE-ASSEMBLY

a-replace thrust washer and o-ring 7-8 and then insert the stem from inside body

b- install the packing ring 3, gland packing 6, spring washer4 and lock nut 2B and tighten. To avoid rotation of stem, apply temporarily the handle install stop washer 17, handle 1, handle nut 2A and tighten (see values given in the table)

9.2 BALL, SEATS AND SEALS RE-ASSEMBLY

a- place the stem in closed position, insert the ball in the same position and rotated in open position

b- insert the seat ring seals 19, and seats 10 from inside end-caps

c- insert the 1° body gasket 11 and 2° body gaskets 18 from inside body

d- tight-in the end connections on the body

10.0 TESTING

a- after having completed the re-assembly check for the manoeuvrability of the valve and make sure that ball rotates freely

b- if facilities are available, test the ball valve to the appropriate specification

11.0 AUTOMATED BALL VALVES

a- if the valve is automated, reinstall the actuators and please note that the handle is not used. If necessary, reset the stops. First set- the valve in open position and check that ball is fully open. Second set- the valve in closed position and check, adjusting if necessary, for the best closure.

b- CAUTION! Valves with electrical actuators should be tested starting from valve in: HALF OPEN - HALF CLOSED POSITION. This is to ensure that electrical connection is all right and rotation is correct. In case of wrong position switch off electrical actuators immediately and change the direction. Limit and torque switches are ineffective if rotation is wrong.